


DIMENSION FROM BACK PANEL TO FRONT OF OPEN DOOR = 18.02"

- REDUNDANT RUN (HIGH LEVEL)
- EXTERNAL VISUAL & AUDIBLE ALARM
- REMOTE SENTRY DRY CONTACTS FOR OPTIONAL POWER LOSS HIGH LEVEL ALARM (POWER LOSS ALARM FOR WIRELESS)
- MANUAL ALARM SILENCE
- MANUAL RUN
- STATUS LED'S: NORMAL, PUMP RUNNING, HIGH LEVEL
- TRouble LED'S: RUN DRY, OVERPRESSURE, BROWNOUT POWERED AND DRY CONTACTS
- CONFORMAL COATED CIRCUIT BOARD (BOTH SIDES)
- PADLOCK DEAD FRONT
- NEMA 4X ENCLOSURE ASSEMBLY


NOTES:

1. AS A MAXIMUM, THE MOTOR SHALL BE A 1 HP, 1725 RPM, 240 VOLT 60 HERTZ, 1 PHASE, CAPACITOR START, BALL BEARING, AIR-COOLED INDUCTION TYPE WITH A LOW STARTING CURRENT NOT TO EXCEED 33 AMPERES AND HIGH STARTING TORQUE OF 8.4 FOOT POUNDS.

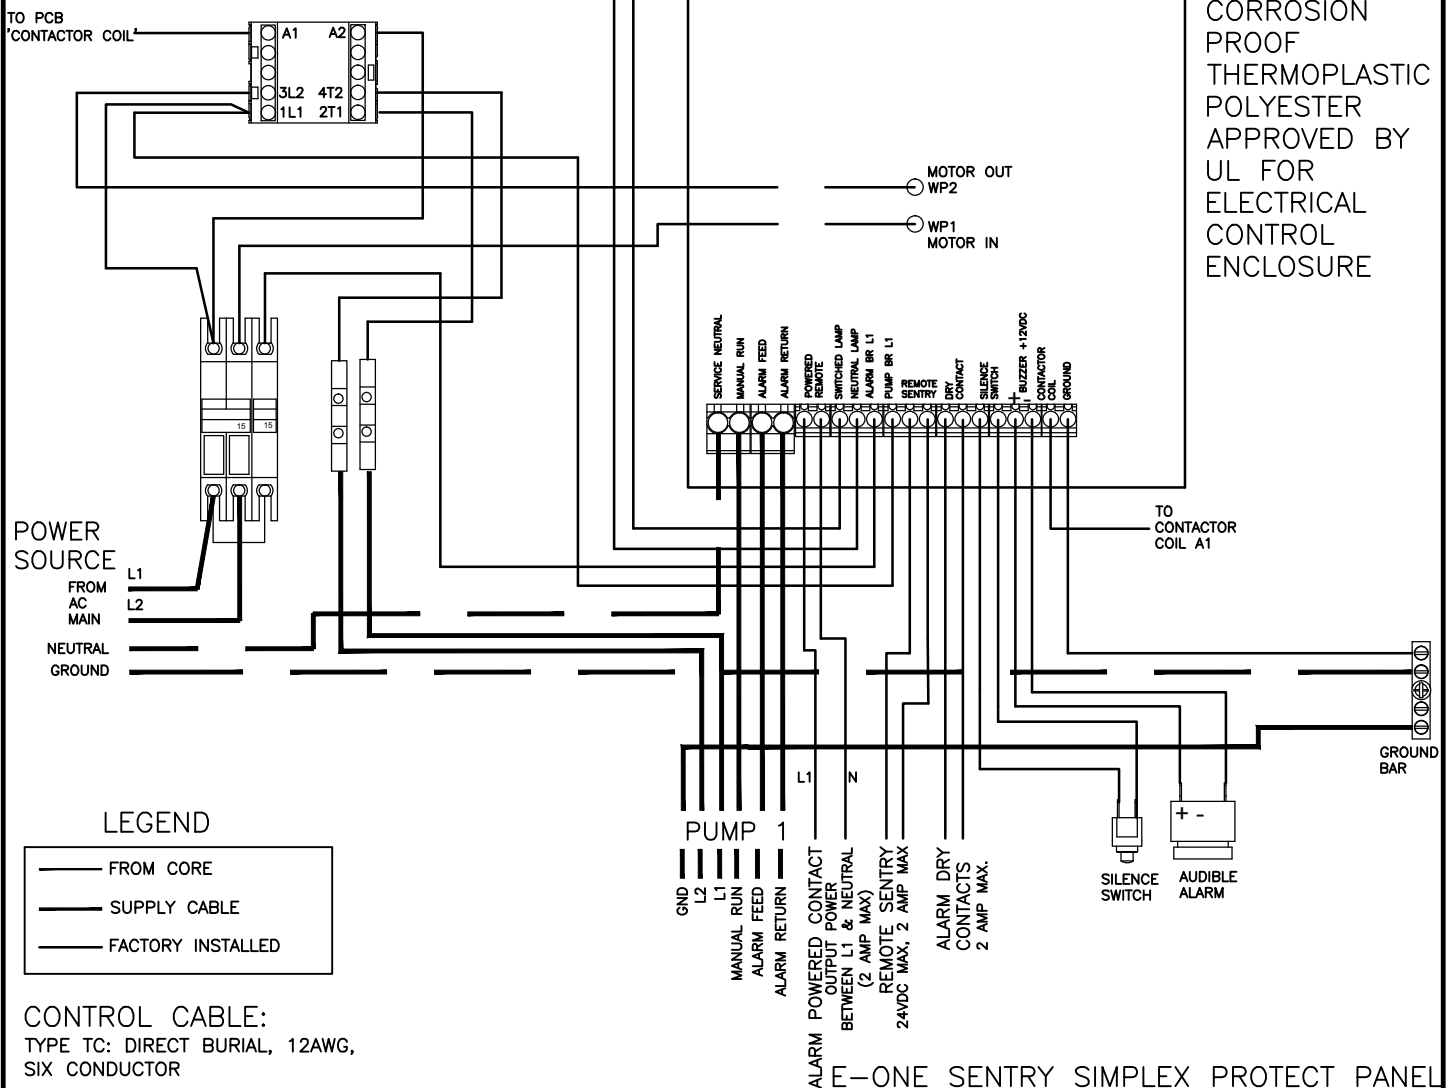

ENCLOSURE:
CORROSION PROOF
THERMOPLASTIC POLYESTER
APPROVED BY UL FOR ELECTRICAL CONTROL ENCLOSURE

LEGEND

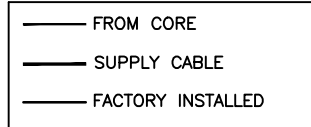

CONTROL CABLE:
TYPE TC: DIRECT BURIAL, 12AWG,
SIX CONDUCTOR

E-ONE SENTRY SIMPLEX PROTECT PANEL

	TRAVIS COUNTY WATER CONTROL AND IMPROVEMENT DISTRICT No. 17 STANDARD DETAILS	GRINDER PUMP STATION SIMPLEX CONTROL PANEL	
	ADOPTED: <p style="text-align: center;">03/01/2016</p>	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. <p style="text-align: center;">WW25</p>