


R.O.W.

NOTE:

WHEN POSSIBLE, LOCATE/COMBINATION AIR/VACUUM RELEASE VALVE ASSEMBLY IN SAME VAULT WITH TWO-WAY CLEANOUT.

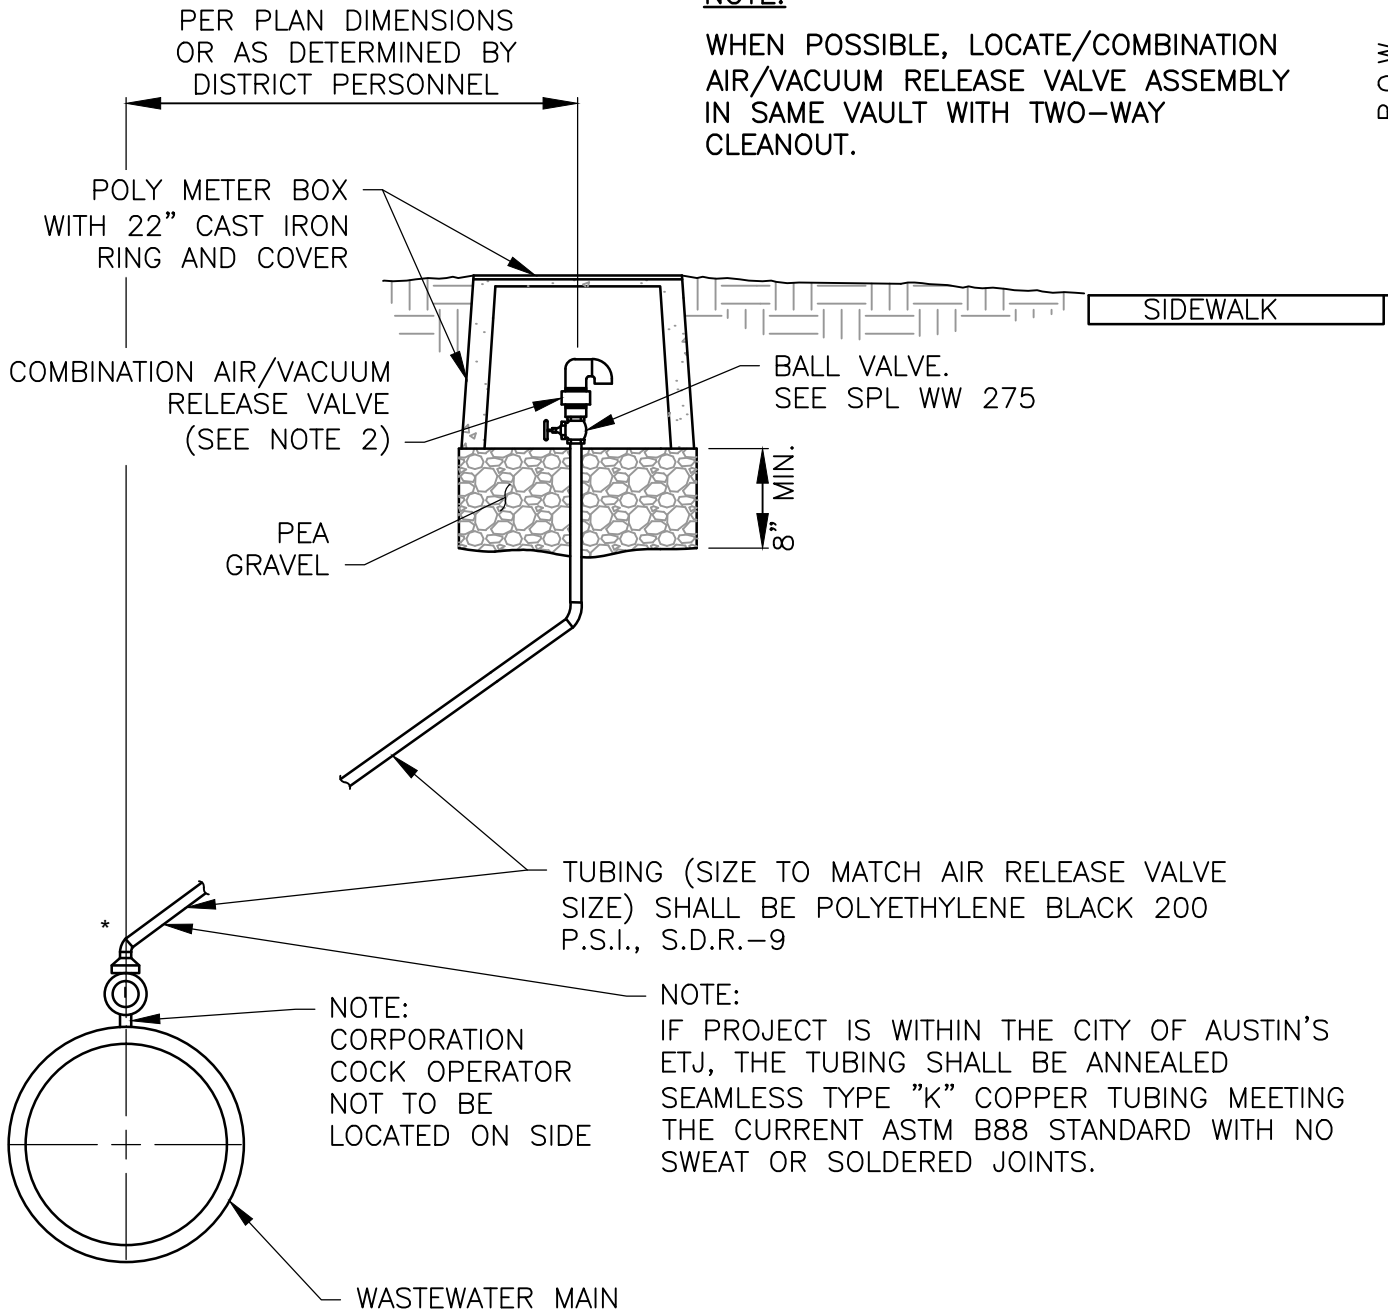


NOTE:
CORPORATION
COCK OPERATOR
NOT TO BE
LOCATED ON SIDE

NOTE:
IF PROJECT IS WITHIN THE CITY OF AUSTIN'S
ETJ, THE TUBING SHALL BE ANNEALED
SEAMLESS TYPE "K" COPPER TUBING MEETING
THE CURRENT ASTM B88 STANDARD WITH NO
SWEAT OR SOLDERED JOINTS.

* THREAD TO COMPRESSION BRASS ELBOW ALLOWED
IF NECESSARY DUE TO DEPTH LIMITATIONS.

NOTES:

1. AUTOMATIC COMBINATION AIR/VACUUM VALVE SHALL BE INSTALLED IN A MANNER WHICH WILL ALLOW REMOVAL OF ASSEMBLY WITHOUT REMOVAL OF THE CONCRETE METER BOX.
2. AUTOMATIC COMBINATION AIR/VACUUM VALVE SHALL BE A MINIMUM SIZE OF 2" (SEE PLANS FOR SIZE) AND SHALL BE MANUFACTURED BY A.R.I. FLOW CONTROL ACCESSORIES, MODEL D-025.

	<p>TRAVIS COUNTY WATER CONTROL AND IMPROVEMENT DISTRICT No. 17 STANDARD DETAILS</p>	<p>NON-VENTED COMBINATION AUTOMATIC AIR/VACUUM RELEASE VALVE INSTALLATION (FORCE MAIN)</p>	
	<p>ADOPTED: 03/01/2016</p>	<p>THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.</p>	<p>DETAIL NO. WW20</p>